



CABINET TYPE			
DIM.	TYPE M	TYPE P	TYPE R
A	36"	44"	44"
B	51"	56"	77"
C	16.88"	25.5"	25.5"

**NOTES:**


- 1). PHOTOCONTROL DEVICE SHALL BE MOUNTED ON BACK OR SIDE OF CABINET ON 90 DEGREE CONDUIT FITTING TO AVOID VEHICLE HEADLIGHT GLARE. PHOTOCONTROL DEVICE CAN ALSO BE INSTALLED INSIDE OF THE CABINET, BEHIND PLEXI-GLASS SHIELD. THE DESIGNER SHALL COORDINATE WITH THE APPLICABLE MAINTENANCE DISTRICT TO DETERMINE THE LOCATION OF THE PHOTOCONTROL DEVICE ON THE CABINET.
- 2). REFER TO STANDARD DETAILS T-4, SHEET 1 AND T-4, SHEET 2 FOR CABINET BASE DETAILS.
- 3). CABINET SHALL BE NEMA 4X AND SHALL BE FABRICATED FROM 0.125 5052-H32 ALUMINUM.
- 4). METER AND LOAD-SIDE DISCONNECT SWITCH TO BE MOUNTED SEPARATELY FROM CABINET. REFER TO STANDARD DETAIL T-17 METERED SERVICE PEDESTAL.
- 5). FOLLOW UP WITH INDIVIDUAL DISTRICTS FOR ANY SOLE SOURCE COMPONENTS WITHIN THE CABINET.

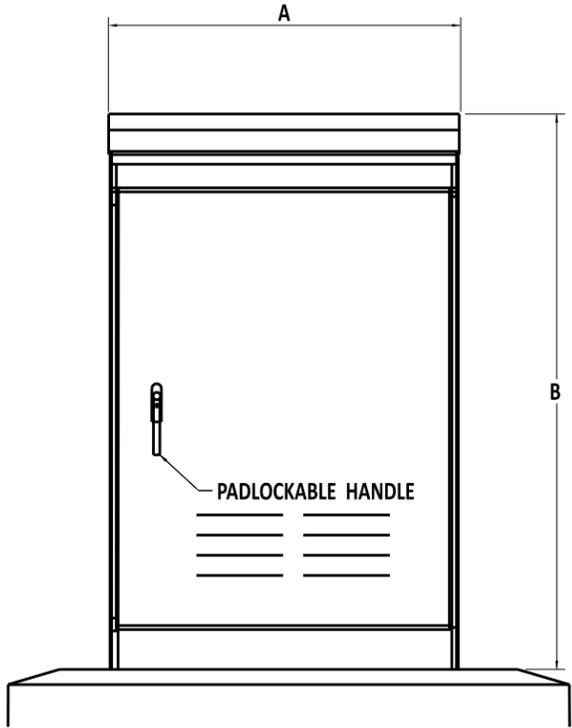

**FRONT VIEW**

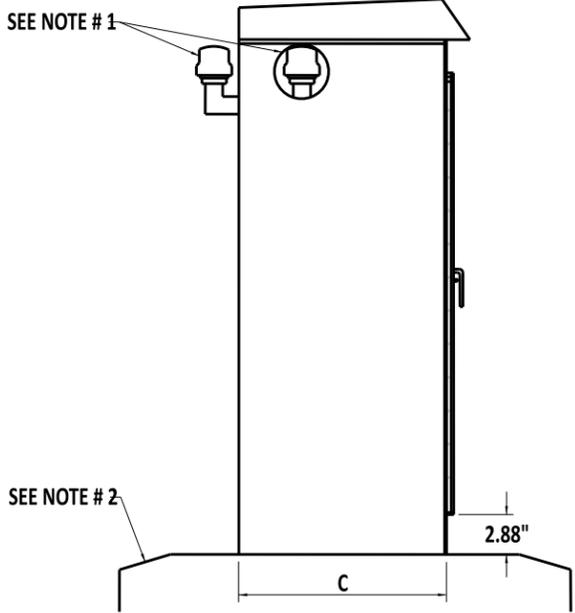

**SIDE VIEW**

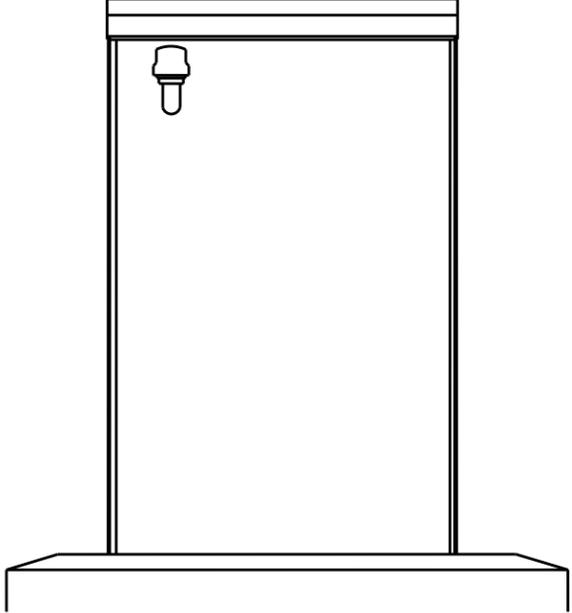


**BACK VIEW**



  
 Andrew Shott  
 ENGINEERING SUPPORT  
 RECOMMENDED  
 12/13/2022  
 DATE

STANDARD LIGHTING CABINET, TYPES M, P, AND R			
STANDARD NO.	T-3 (2022)	SHT.	1 OF 1

REVIEWED		12/16/2022
APPROVED		12/21/2022